

# SUMCT – SUMMATION CURRENT TRANSFORMER



## 1. WORKING PRINCIPAL

Summation current transformers are used to add up secondary currents of multiple main current transformers to measure with one instrument only.

The currents are always vectorially added under consideration of the amount and phase disposal of the current so it can be used for measuring active or reactive power, energies, and total power factor of the system.

The output signal is again a standardized signal which is received by adding the input currents by the quantity of inputs and the ratio of inputs.

As mentioned above, the currents are always vectorially added, so the output is very different, and not easy to check by any clamp and multimeter. For ease of understanding, we assume the input currents have the same phase angle, only different amplitudes.


We are considering a summation current transformer with two inputs 1000/5A and one output 2000/5A.

The formula is shown as below:

$$I_{out} \frac{2000}{5} = A \frac{1000}{5} + B \frac{1000}{5}$$

Where: A, B: inputs from standard 5A CT

$I_{out}$ : output, standard 5A secondary side.

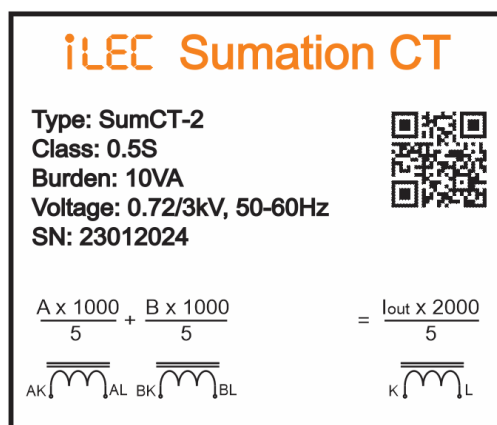

The sample values for inputs and output as below tables:

% Inputs	A (A)	B (A)	$I_{out}$ (A)	Output current with CT Ratio 2000/5 (A)
5%	0.25	0.25	0.25	100
20%	1.0	1.0	1.0	400
50%	2.5	2.5	2.5	1000
100%	5.0	5.0	5.0	2000
120%	6.0	6.0	6.0	2400

Table 1.1: Output current for the same input signals.

% Input A	A (A)	% Input B	B (A)	I <sub>out</sub> (A)	Output current with CT Ratio 2000/5 (A)
5%	0.25	0%	0.0	0.125	50
20%	1.0	0%	0.0	0.5	200
50%	2.5	0%	0.0	1.25	500
100%	5.0	0%	0.0	2.5	1000
120%	6.0	0%	0.0	3.0	1200

Table 1.2: Output current for one input signal A.

The ratios of the main unequal CTs have always been advised together with the order because the primary input currents are always weighted accordingly. The ratio of the primary currents should not be more than 10 : 1 (biggest to smallest primary current).

The sum of the currents can add up to Zero e.g. in case of a differential current measurement. The standard application is the addition of currents of the same phase. With a reverse connection of the main current transformers, it is also possible to subtract currents.

## Testing diagram:

The easiest way to test the sum CT is connecting all primary inputs in series with the forward direction and test as a 5A:5A current transformer.

## Important notes when using:

1. Unconnected secondary currents **MUST BE short-circuited**
2. Unused primary terminals have to remain open and shall never be short-circuited in contrary to the secondary terminals. (avoid keeping unused primary inputs)
3. Connecting correct current transformer with exactly ratio to all primary inputs
4. The burden of the current transformer connected to the primary input must be sufficient to ensure the output power.

## 2. APPLICATIONS

- Measuring from two or more distribution transformers for zero-export solar system (LV side)
- Measuring from two or more distribution MCCB / Transformer for one customer
- Measuring from two or more distribution branches for one capacitor panel

### 3. TECHNICAL PARAMETERS


- Highest voltage equipment : 720 V
- Rated insulation level : 3 kV, 1 min.
- Rated short-time thermal current (Ith) : 50 x In
- Rated dynamic current (Idyn) : 2.5 x Ith
- Frequency range : 50 - 60Hz
- Internal consumption : Max. 4 VA
- Output current : 5A (1A can be ordered)
- Maximum continuous current : 6A
- Instrument security factor (FS) : < 5
- Thermal class of insulation : E
- Accuracy class index and burden : Class 0.5 10VA, CL0.5S (CL 1 for some unequal CTs)
- Fixing : DIN-rail or screw fastening

### 4. ORDERING CODE STRUCTURER

#### SumCT-x-y

Where: x: number of inputs, for unequal CTs, please send ratio for each CT.  
y: number of outputs, (y =1 by default)

### 5. DIMENSION

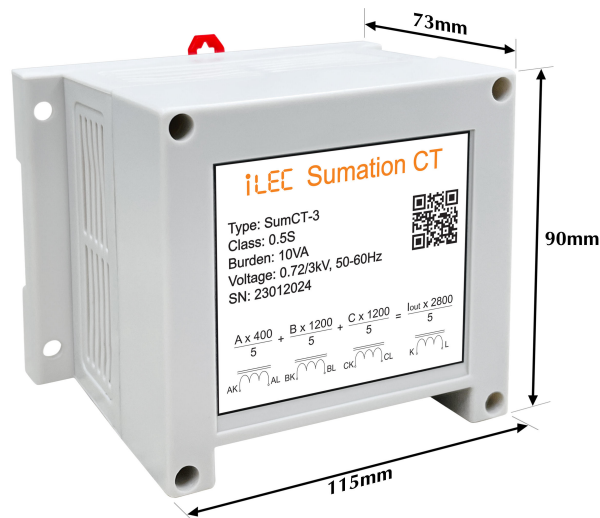

#### ILEC ELECTRIC EQUIPMENT CO., LTD

Address: 76 street no 20, Tan Binh Industrial Park Expansion, Hoa Ward, Binh Tan District

Tax code: 0313550072

Tel: (84-28) 37657746 - Email: admin@ilec.com.vn - Web: ilec.com.vn - Facebook: ilec.com.vn