

48 x 48mm

Features:

- 4+4 digits, 7 segment LED dual display
- TC / RTD input
- PID / ON OFF control
- Auto tune / Self tune
- Two set points
- °C / °F selectable
- Field selectable control output (Relay or SSR)
- Auxiliary output : Relay / SSR

Display specifications

Display	4+4 digits, 7 Segment LED dual display
	Height of upper display: 15.3mm
	Height of lower display : 8mm
LED indication	1. Output 1 ON T: Auto tune
	2. Output 2 ON S: Dwell timer

Input specifications

_		
	Inputs Resolution	Thermocouple (J, K, T, R, S) / RTD (PT100) 0.1 / 1° for TC / RTD inputs (fixed 1° for R & S type TC input)
	Indication accuracy	For J, K & T inputs: 0.25% of F.S. ±1° For R & S inputs: 0.5% of F.S. ±2° (20 min of warm up time for TC inputs) For RTD inputs: 0.1% of F.S. ±1° (F.S. = Full scale)
	Temperature unit	°C / °F selectable
	Input filter (FTC)	0.2 to 10.0sec
	Sampling time	250 ms

Output specifications

Control output (Relay or SSR user selectable)		
Relay contact (SPST) SSR drive (Voltage pulse)	5A resistive @ 250V AC / 30V DC 12V DC, 30 mA	
Auxiliary output		
Relay contact (SPST)	5A resistive @ 250V AC / 30V DC	

Functional specifications		
Control action	PID Control with auto tuning ON-OFF control	
Proportional band (P)	1.0 to 400.0°	
Integral time (I)	0 to 9999 sec	
Derivative time (D)	0 to 9999 sec	
Cycle time	0.1 to 99.9 sec	
Hysteresis width	0.1 to 99.9°	
Manual reset value	-19.9 to 19.9°	
Heat-cool		
Control action	PID	
Proportional band-cool	0.0 to 400.0°	
Cycle time-cool	0.1 to 99.9 sec	
Dead band	Programmable from set point low limit to set point high limit.	
Settings for alarm output		
Modes	Deviation, Absolute	
Hysteresis	0.1 to 99.9°	

Auxiliary supply specifications

Supply voltage	90 to 270V AC / DC (50 / 60Hz)
Power consumption	6 VA max @ 230V AC


Environmental specifications

Temperature	Operating : 0°C to 50°C Storage : -20°C to 75°C
Humidity (non - condensing)	95% RH


Mechanical specifications

Mounting	Panel	
Weight	116 gms	

Dimension (All are in mm)

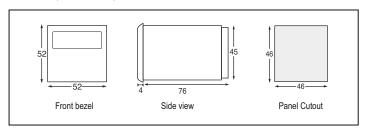

Terminal Connection

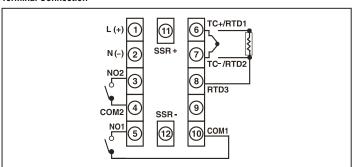

Compliance

Applicable EMI / EMC standards					
Product standard : IEC 61326-1					
Category		Standards compliance			
ESD immunity	IEC 61000-4-2	Level III			
Surge immunity	IEC 61000-4-5	+/- 2 kV common mode, +/- 1 kV differential mode			
Radiated susceptibility	IEC 61000-4-3	Level III, 80 to 1000MHz Level II, 1.4GHz to 2GHz Level I, 2GHz to 2.7GHz			
Conducted susceptibility IEC 61000-4-6		Level II			
Voltage dips and interruptions	IEC 61000-4-11	Dips: 0% residual voltage / 1 cycle (Criteria B), 40% residual voltage / 10 cycles 50Hz / 12 cycles 60Hz (Criteria C)70% residual voltage / 25 cycles50Hz / 30 cycles 60Hz (Criteria C) Interruptions: 0% residual voltage / 250 cycles 50Hz / 300 cycles 60Hz (Criteria C)			
Conducted emission	CISPR-11				
Radiated emission	CISPR-11				
Electrical fast transient	IEC 61000-4-4	Level III			

Ordering Information

Product code	Output 1		Output 2	Supply voltage	Certification
TC544C	RELAY	SSR	RELAY	90 to 270V AC / DC	C€

Accessories (Optional)

Standard SELEC accessories that can be used with this product.

Adapter plate

1) AP7248 : Plastic adapter plate, used to mount 1/16 DIN (cutout size 48 x 48) Instrument into existing (72 x 72) cutout size.

2) AP9648: Plastic adapter plate, used to mount 1/16 DIN (cutout size 48 x 48) Instrument into existing (96 x 96) cutout size.

3) AP4896-4848-G-C: Plastic adapter plate, used to mount 1/16 DIN (cutout size 48 x 48) Instrument into existing (48 x 96) cutout size.


Mounting accessories (Supplied with units)

|--|

Input sensor ranges

	Resolution	Ran	iges
Sensor type		1	0.1
PT100	°C	-150 to 850	-150 to 850
F1100	°F	-238 to 1562	-199 to 999
J	°C	-199 to 750	-199 to 750
	°F	-328 to 1382	-199 to 999
К	°C	-199 to 1350	-199 to 999
	°F	-328 to 2462	-199 to 999
T	°C	-199 to 400	-199 to 400
	°F	-328 to 750	-199 to 750
R & S	°C	0 to 1750	N/A
	°F	32 to 3182	N/A

Independent Downloader module (IDM)

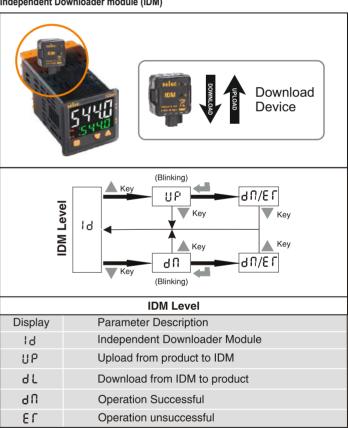

www-selec-com

16

	48 x 48	
PARAMETERS	SPECIFICATIONS	
Display	4 digits (White) + 4 digits (Green) Display Height:- White Display:- 15.3 mm Green Display:- 8 mm 7 segment digital display	
LED Indications	1 : Output 1 ON 2 : Output 2 ON T : Tune S : Dwell Timer	
Keys	3 keys for digital setting	
INPUT SPECIFICATION	NS	
Input Signal	Thermocouple (J,K,T,R,S) / RTD (PT100)	
Sampling time	250 msec	
Input Filter (FTC)	0.2 to 10.0 sec	
Resolution	0.1 / 1° for TC/RTD input (Fixed 1° for R & S type TC input)	
Temperature Unit	°C / °F selectable	
Indication Accuracy	For TC inputs: 0.25% of F. S±1°C For R & S inputs: 0.5% of F. S±2°C (30 min of warm up time for TC input) For RTD inputs: 0.1% of F. S±1°C	
FUNCTIONAL SPECIFICATIONS		
Control Method	PID control with Auto or Self Tuning ON-OFF control	
Proportional Band(P)	1.0 to 400.0°C, 1.0 to 752.0°F	
Integral Time(I)	0 to 9999 sec	
Derivative Time(D)	0 to 9999 sec	
Cycle Time	0.1 to 99.9 sec	
Hysteresis Width	0.1 to 99.9°C	
Dwell Timer	0 to 9999 min	
Manual Reset Value	-19.9 to 19.9°C / °F	
HEAT COOL PID SPECIFICATIONS		
Control Method	PID	
Proportional Band-Cool	1.0 to 400.0°C 1.0 to 752.0°F	
Cycle Time-Cool	0.1 to 99.9 sec	
Dead Band	SPLL to SPHL(Programmable)	

OUTPUT SPECIFICATIONS		
Control Output (Relay or SSR user selectable)	Relay Contact : 5A resistive@250V AC / 30V DC	
user selectable)	SSR Drive Output (Voltage Pulse): 12V DC, 30 mA	
Auxiliary Output	Relay Contact : 5A resistive@250V AC / 30V DC	
POWER SUPPLY SPECIFICATIONS		
Supply Voltage	85 to 270V AC / DC (AC : 50 / 60 Hz)	
Power Consumption	6 VA max@270V AC	
Temperature	Operating: 0 to 50°C Storage: -20 to 75°C	
Humidity	95% RH (non-condensing)	
Weight	116 g	

SAFETY PRECAUTIONS

All safety related codifications, symbols and instructions that appear in this operating manual or on the equipment must be strictly followed to ensure the safety of the operating personnel as well as the instrument.

If the equipment is not handled in a manner specified by the manufacturer it might impair the protection provided by the equipment.

 Read complete instructions prior to installation and operation of the unit.

WARNING: Risk of electric shock.

WIRING GUIDELINES

WARNING :

- 1. To prevent the risk of electric shock power supply to the equipment must be kept OFF while doing the wiring arrangement. Do not touch the terminals while power is being supplied.
- 2. To eliminate electromagnetic interference use short wire with adequate ratings; twists of the same in equal size shall be made. For the input and output signal lines, be sure to use shielded wires and keep them away from each other.
- 3. Cable used for connection to power source, must have a cross section of 1mm2 or greater. These wires shall have insulation capacity made of at least 1.5kV.
- 4. When extending the thermocouple lead wires, always use thermocouple compensation wires for wiring. For the RTD type, use a wiring material with a small lead resistance (5 Ω max per line) and no resistance differentials among three wires.
- 5. A better anti-noise effect can be expected by using standard power supply cable for the instrument.

MAINTENANCE

- 1. The equipment should be cleaned regularly to avoid blockage of ventilating parts.
- 2. Clean the equipment with a clean soft cloth. Do not use Isopropyl alcohol or any other cleaning agent.

INSTALLATION GUIDELINES

- 1. This equipment, being built-in-type, normally becomes a part of main control panel and in such case the terminals do not remain accessible to the end user after installation and Internal wiring.
- 2. Do not allow pieces of metal, wire clippings, or fine metallic fillings from installation to enter the product or else it may lead to a safety hazard that may in turn endanger life or cause electrical shock to the operator.
- 3. Circuit breaker or mains switch must be installed between power source and supply terminals to facilitate power 'ON' or 'OFF' function. However this switch or breaker must be installed in a convenient position normally accessible to the operator.
- 4. Use and store the temperature controller within the specified ambient temperature and humidity ranges as mentioned in this manual.

CAUTION

- 1. When powering up for the first time, disconnect the output connections.
- 2. Fuse Protection: The unit is normally supplied without a power switch and fuses. Make wiring so that the fuse is placed between the mains power supply switch and the controller. (2 pole breaker fuse - rating : 275V AC,1A for electrical circuitry is highly recommended)
- 3. Since this is a built-in-type equipment (finds place in main control panel), its output terminals get connected to host equipment. Such equipment shall also comply with basic EMI/EMC and other safety requirements like BSEN61326-1 and BSEN 61010 respectively.
- Thermal dissipation of equipment is met through ventilation holes provided on chassis of equipment. Such ventilation holes shall not be obstructed else it can lead to a safety hazard.
- 5. The output terminals shall be strictly loaded to the manufacturer specified values / range.

MECHANICAL INSTALLATION Panel cutout Outline Dimensions (in mm) (in mm)


- 1. Prepare the panel cutout with proper dimensions as shown
- 2. Fit the unit into the panel with the help of clamp given.
- 3. The equipment in its installed state must not come in close proximity to any heating sources, caustic vapors, oils, steam or other unwanted process by-products.
- 4. Use the specified size of crimp terminals (M3.5 screws) to wire the terminal block. Tighten the screws on the terminal block using the tightening torque within the range of 1.2
- 5. Do not connect anything to unused terminals.


EMC GUIDELINES

- 1. Use proper input power cables with shortest connections and twisted type.
- 2. Layout of connecting cables shall be away from any internal EMI source.

LOAD CONNECTIONS

- 1. The service life of the output relays depends on the switching capacity and switching conditions. Consider the actual application conditions and use the product within the rated load and electrical service life.
- 2. Although the relay output is rated at 5/10 amps it is always necessary to use an interposing relay or contactor that will switch the load. This avoids damage to the controller in the event of a fault short developing on the power output circuit.
- 3. Always use a separate fused supply for the "power load circuit" and do not take this from the live and neutral terminals supplying power to the controller.






ELECTRICAL PRECAUTIONS DURING USE

Electrical noise generated by switching of inductive loads can create momentary disruption, erratic display. latch up, data loss or permanent damage to the instrument.

To reduce noise:


- a) Use of snubber circuits across loads as shown above, is recommended.
- b) Use separate shielded wires for inputs.



Use only the correct thermocouple wire or compensating cable from the probe to instrument terminals avoiding joints in the cable if possible. Failure to use the correct wire type will lead to inaccurate readings.

Ensure that the input sensor connected at the terminals and the input type set in the temperature controller configuration are the same.

FRONT PANEL DESCRIPTION



Process-value (PV) / Parameter name display	Displays a process value (PV). Displays the parameter symbols at configuration mode/online menu. Displays PV error conditions. (refer Table 2)
Parameter setting display	Displays the parameter settings at configuration mode/online menu.
Control output 1 indication	The LED is glow when the control output 1 is ON
Control output 2 indication	The LED is glow when the control output 2 is ON
5 Tune	Auto tune : Blinking (With faster rate) Self tune : Blinking (With slower rate)
6 Dwell timer	Blinking : Dwell timer is in progress. Continuous ON : Time over.

FRONT KEYS DESCRIPTION		
FUNCTIONS	KEY PRESS	
ONLINE		
To view Level 1	Press ♥ key for 3 sec.	
To view Level 2	Press A key for 3 sec.	
To view Protection Level	Press ▲ + ♥ keys for 3 sec.	
To view online parameters	Lower display selectable between SET1/SET2/TIME using ▲ key.	
NOTE: Elapsed time / Remaining time dependent on the selection of ONL parameter in level1.		
To change online	Press ■+ ▲/♥ to change	

DROCRAMMING MODE			
parameter values	parameter value.		
to change online	Press + A/ to change		

PROGRAMMING MODE To view parameters on ♠ or ♥ key once to view the next or previous function in operational menu the same level. To increase or decrease

+ to increase and + to the value of a particular decrease the function value parameter. Note: Parameter value will not alter when respective level is locked.

NOTE: The unit will auto exit programming mode after 30 sec. of inactivity.

OR By pressing the a or or a + keys for 3 sec.

Table 1 : INPUT RANGE			
FOR RTD			
INPUT TYPE	RANGE		
	Resolution: 1	Resolution: 0.1	UNIT
PT100	-150 to 850	-150.0 to 850.0	°C
	-238 to 1562	-199.9 to 999.9	°F

FOR THERMOCOUPLE			
INPUT TYPE	RANGE		
	Resolution: 1	Resolution: 0.1	UNIT
J	-199 to 750	-199 to 750	°C
,	-328 to 1382	-199 to 999	°F
к	-199 to 1350	-199 to 999	ů
, ,	-328 to 2462	-199 to 999	°F
_	-199 to 400	-199 to 400	°C
'	-328 to 750	-199 to 750	°F
ВС	0 to 1750	N/A	°C
R, S	32 to 3182	N/A	°F

Table 2: ERROR DISPLAY

When an error has occurred, the upper display indicates error codes as given below.

· · · · · · · · · · · · · · · · · · ·		
Error	Description	Control Output Status
5.6 ቦ	Sensor break / Over range condition	OFF
S.n.e	Sensor reverse / Under range condition	OFF

Programming online parameters

Setpoint 1 Default: 50

Range: SPLL to SPHL

If upper display is selected as 5 E L ! then,

Pressing ■ key will show on Upper display: 5 € ₺ 1 Lower display: <50>

Press ■+ A / ▼ keys to increment / decrement 5 E Ł ! value





Setpoint 2 / Dead band

Default: 0

Range: SPLL to SPHL

If upper display is selected as 5 E & 2/d b then, Pressing ■key will show on Upper display:58 € 2/d 6 Lower display: <0>

Press ■ + ▲ / ▼ keys to increment / decrement SEE2/db value.





Dwell Timer

Default : OFF

Range: OFF, 1 to 9999 min

If upper display is selected as £. PEn/Ł. ELP then, Pressing ■ key will show on Upper display : Ł i n E Lower display : <OFF>

Press ■ + ▲ / ♥ keys to increment / decrement d 4 € L time value.


USER GUIDE

- 1. Display Bias: This function is used to adjust the PV value in cases where it is necessary for PV value to agree with another recorder or indicator, or when the sensor cannot be mounted in correct location.
- 2. Filter Time Constant: The input filter is used to filter out quick changes that occur to the process variable in a dynamic or quick responding application which causes

The digital filter also aids in controlling processes where the electrical noise affects the input signal.

Larger the value of FTC entered, greater the filter added and the slower the controller reacts to the process and

- 3. Auto tune (AT): The Auto-tuning function automatically computes and sets the proportional band (P), integral time (I), Derivative time (D), ARW% and cycle time (CY.T) as per process characteristics.
- Tune LED blinks at faster rate when auto-tuning is in
- At the completion of Auto-tuning, Tune LED stops blinking. PID - time proportioning with auto reset & rate





- If the power goes OFF before auto-tuning is completed, Auto-tuning will be restarted at next power ON.
- If auto-tuning is not completed after 3-4 cycles, the autotuning is suspected to fail. In this case, check the wiring & parameters such as the control action, input type, etc.
- Carry out the auto-tuning again, if there is a change in setpoint or process parameters.
- 4. ON/OFF control action (For Reverse Mode):

The relay is 'ON' up to the set temperature and cuts 'OFF' above the set temperature. As the temperature of the system drops, the relay is switched 'ON' at a temperature slightly lower than the set point.


HYSTERESIS:

The difference between the temperature at which relay switches 'ON' and at which the relay switches 'OFF' is the hysteresis or dead band.






5. Manual Reset (for PID control & I = 0): After some time the process temperature settles at some point and there is a difference between the set temperature & the controlled temperature. This difference can be removed by setting the manual reset value equal & opposite to the offset.



- 6. Self Tune (ST): It is used where modification of PID parameters is required repeatedly due to frequent change in process condition eg. Setpoint.
- Tune LED blinks at slower rate when Self-tuning is in
- At the completion of self-tuning, Tune LED stop blinking.



- Self-tuning is initiated under the following conditions:
- 1) When setpoint is altered.
- 2) When tune mode is altered. (TUNE=ST)
- ST will start only if PV < 50% of setpoint.
- ST will work only when ACT=RE.


7. Thermocouple Compensation:

COMP - YES

Configure Yes if compensating cable is connected as thermocouple extension. Yes should also be configured in the case if the sensor is directly connected to the terminal without extension.

COMP = NO

Configure No if non-compensating cable is connected as thermocouple extension.




**IDM is applicable only for IDM compatible Product.

Display	Parameter Description
ldā	IndependentDownloader Module
ՍԲԼԺ	Upload from product to IDM
9019	Download from IDM to product
9008	Operation Successful
ELL	Operation unsuccessful

- 1) IDM Level IDM should be connected before powering on the unit to enter in IDM Level.
- 2) Long Press or wkey for 3 sec to exit from IDM mode.

Caution: After Downloading, switch of the unit and then remove the IDM

Doc. Name: OP INST TC544C

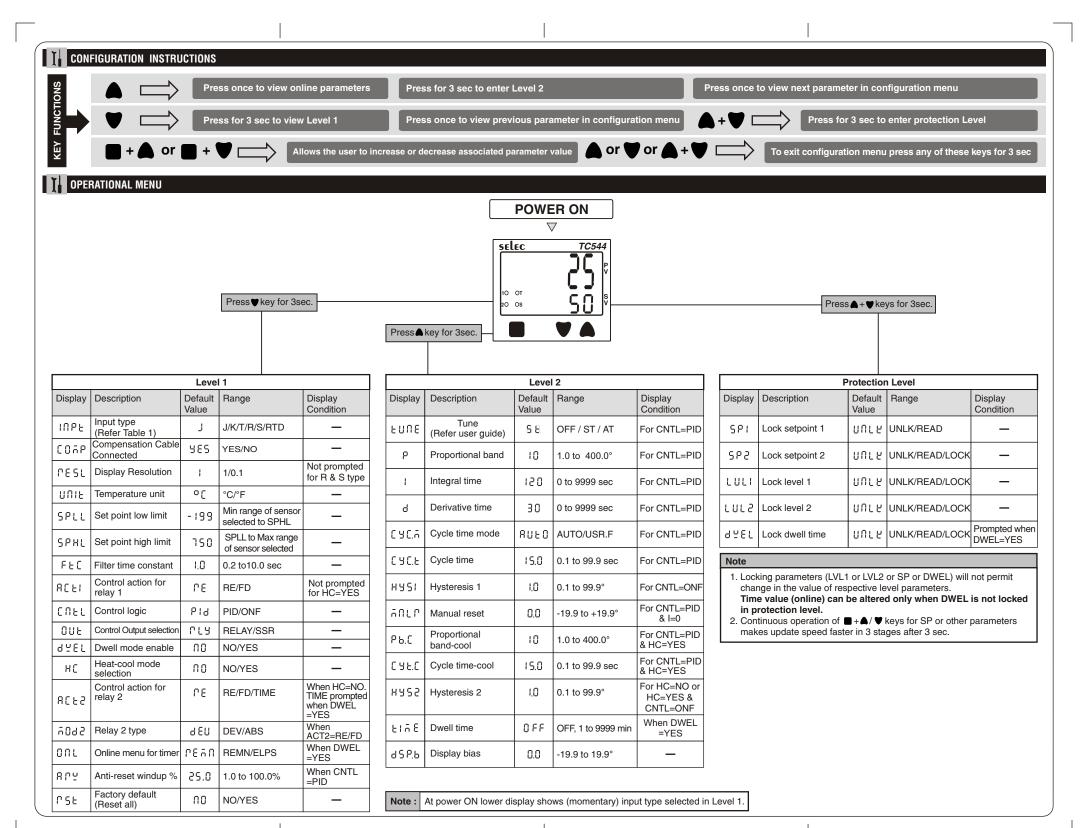

CALIBRATION CERTIFICATE

Model No: TC544C

Claimed Accuracy:

For TC inputs : 0.25% of FS ±1°C For R & S inputs: 0.5% of F.S ±2°C (30 min of warm up time for TC input) For RTD inputs : 0.1% of FS ±1°C

Standard used for Calibration of product is traceable to NABL

The calibration of this unit has been verified at the following values:

SENSOR SELECTION	VERIFICATION VALUE (°C)
	25.0
K	475.0
	975.0
	0.0
RTD	323.5
	800.0

The thermocouple / RTD curves are linearized in this microprocessor based product; and hence the values interpolated across the input range are also equally accurate; at every point in the curve.

Unit is accepted as accuracy is within the specified limit of claimed accuracy and certificate is valid upto one year from the date of issue.

(Specifications are subject to change, since development is a continuous process.)

Selec Controls Pvt. Ltd., India

Factory Address :

EL-27/1, Electronic Zone, TTC Industrial Area, MIDC, Mahape, Navi Mumbai - 400 710, INDIA.

Tel. No.: +91-22-41 418 452/468 | Fax No.: +91-22-28471733 Toll free: 1800 227 353 (BSNL/MTNL Subscribers only) Website: www.selec.com | Email: sales@selec.com

Doc. Name : OP INST TC544C OP723-V03(Page 4 of 4)